
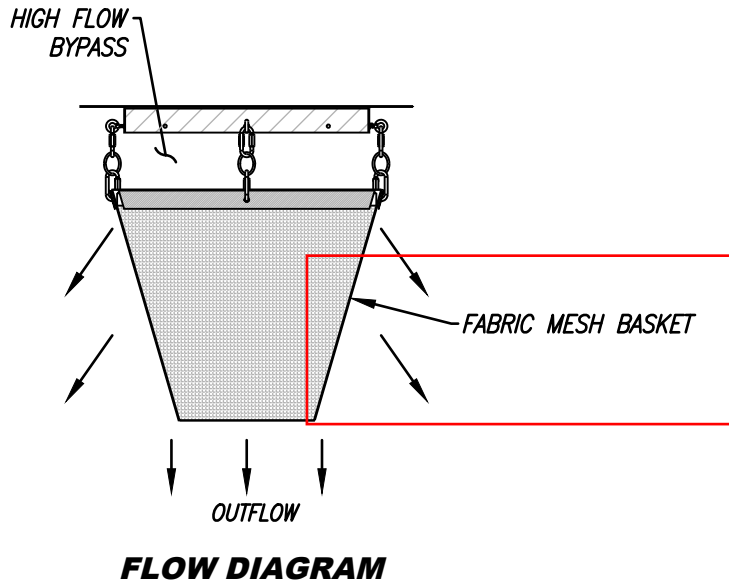


# BIO CLEAN FABRIC SEDIMENT FILTER

## FOR USE IN GRATE INLETS

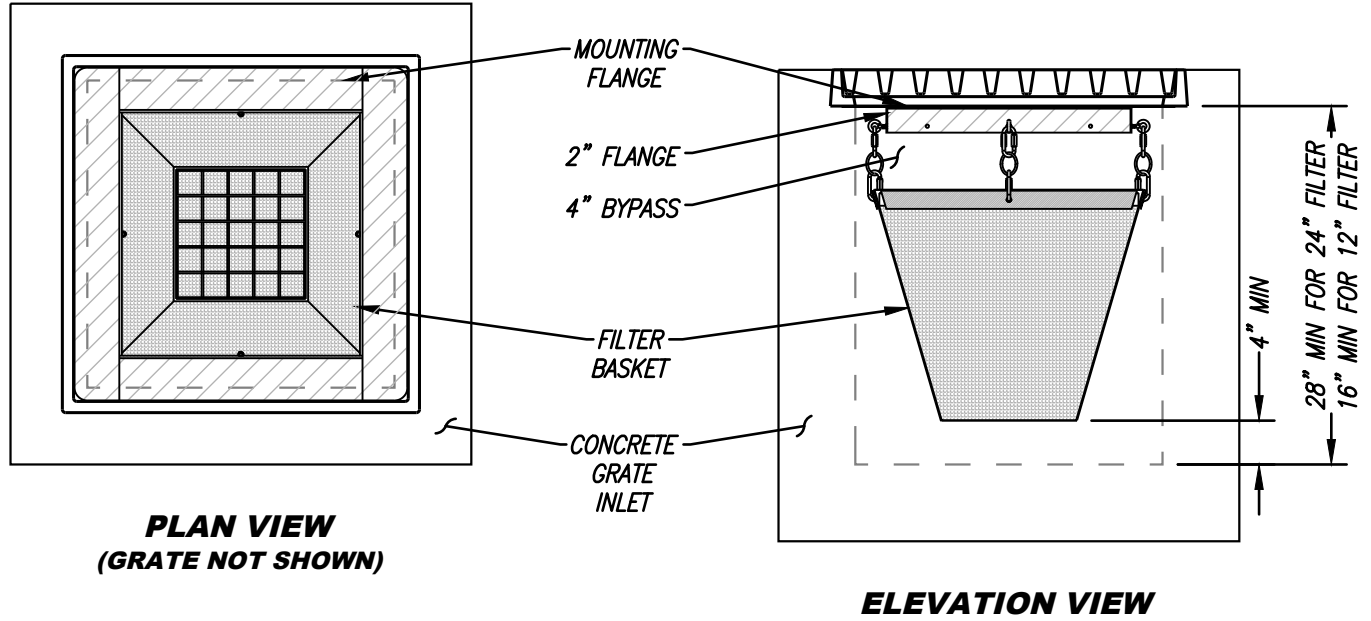

### INSTALLATION NOTES

1. ALL HARDWARE, FLANGE, AND FRAME SHALL BE STAINLESS STEEL.
2. OPTIONAL HYDROCARBON BOOM SHALL BE 2-INCH DIAMETER.
3. CONSIDERS A LOCAL DEPRESSION PONDING DEPTH OF 6 INCHES.
4. STORAGE CAPACITY BASED ON BASKET HALF FULL.
5. CONCRETE STRUCTURES SOLD SEPARATELY.

Note: Fabric filters are not Full Trash Capture Certified

NOT TO SCALE

MODEL #	TREATMENT FLOW RATE (CFS)	BYPASS FLOW (CFS)	SOLIDS STORAGE CAPACITY (CF)
BIO-GRATE-FABRIC 12-12-12	0.47	1.24	0.15
BIO-GRATE-FABRIC 18-18-12	0.79	2.79	0.33
BIO-GRATE-FABRIC 24-24-12	1.18	4.97	0.59
BIO-GRATE-FABRIC 24-40-12	1.61	6.35	0.88
BIO-GRATE-FABRIC 24-24-24	2.01	4.96	1.22
BIO-GRATE-FABRIC 24-40-24	2.58	6.35	1.82
BIO-GRATE-FABRIC 36-36-24	3.18	7.74	2.73

PROPRIETARY AND CONFIDENTIAL:

THE INFORMATION CONTAINED IN THIS DOCUMENT IS THE SOLE PROPERTY OF QUIKRETE AND ITS COMPANIES. THIS DOCUMENT, NOR ANY PART THEREOF, MAY BE USED, REPRODUCED OR MODIFIED IN ANY MANNER WITHOUT THE WRITTEN CONSENT OF QUIKRETE.



**GRATE INLET FILTER  
FABRIC  
STANDARD DETAIL**

I:\STOR\WATER\COMMOPS\59\_FILTER\_INSERT\59\_FILTER\_INSERT\FABRIC\FABRIC GRATE INLET\_FILTER.DWG 8/20/2024 11:29 AM